VAULTS
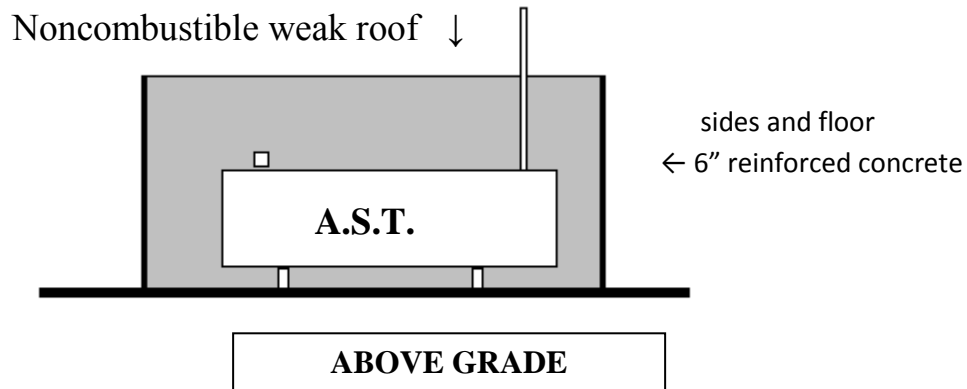
VAULTS SHALL BE PERMITTED
EITHER ABOVE OR BELOW GRADE

Noncombustible weak roof ↓

sides and floor
← 6" reinforced concrete

A.S.T.

ABOVE GRADE

BELOW GRADE

sides and floor
← 6" reinforced concrete

A.S.T.